



V2A

REF. AVE358XX

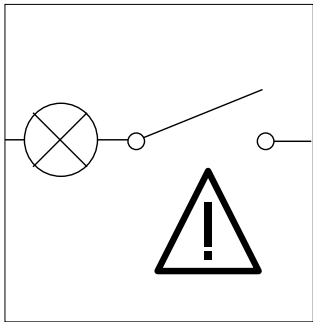


1. Before any intervention, cut off the fan supply from the circuit breaker.

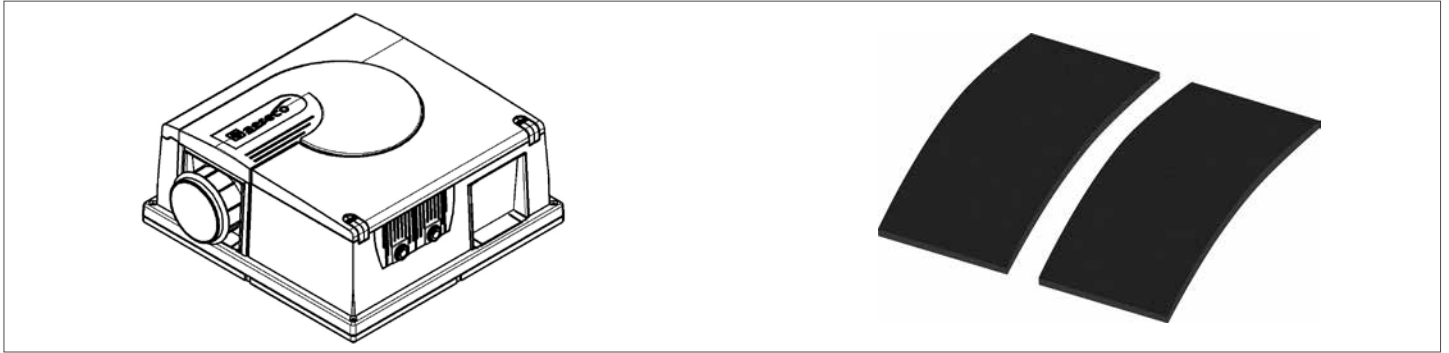


5. Position back the filter supports.




2. Withdraw the lid.

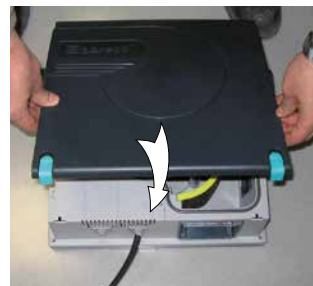


6. Place the lid.

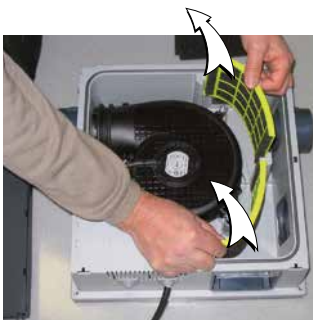


3. Withdraw the worn filter supports.

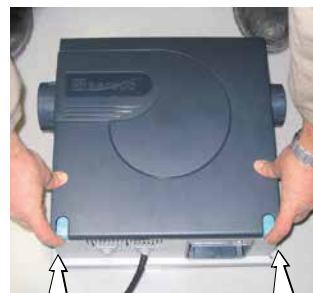


7. Close the lid.

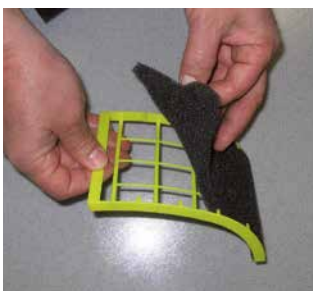

4. Replace worn filters by the 2 provided new ones.

 Make sure the filters are well set up on their supports in order to avoid leaks.

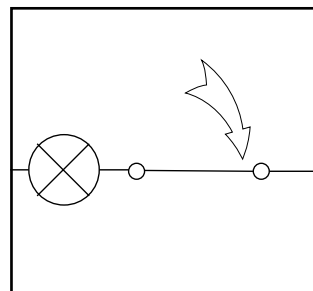

8. Engage the circuit breaker in order to supply the fan and check its operation.